

Refrigeration Notes

Connecting 5V d.c. to AK-SC255 DIN style controllers

Information	Target	Subject
<input checked="" type="checkbox"/> Sales Info	<input type="checkbox"/> Commercial	<input type="checkbox"/> Commercial refrigeration
<input checked="" type="checkbox"/> Product Info	<input checked="" type="checkbox"/> Technical	<input type="checkbox"/> Industrial refrigeration
<input checked="" type="checkbox"/> Application info		<input checked="" type="checkbox"/> Electronic refrigeration
<input type="checkbox"/> OEM Info		




Be sure when connecting 5 V d.c. power that correct polarity is maintained:

+ to Vin & - to Gnd

Ensure the power input connector (located on the AK-SC255 DIN) is correctly seated and aligned

Failure to maintain polarity and correct connector alignment may cause damage to the AK-SC255 DIN

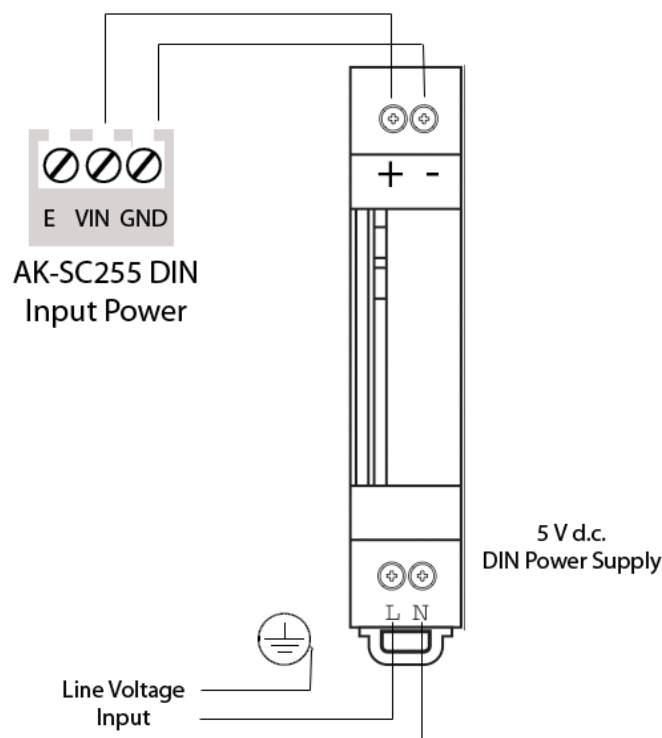

ADAP-KOOL® Refrigeration Control Systems is a trademark of Danfoss A/S, www.danfoss.com
 Danfoss Inc., Refrigeration & Air-Conditioning Division, 7941 Corporate Drive, Baltimore, MD 21236 Tel. 410-931-8250, Fax 410-931-8256,
www.danfoss.com/North_America

Danfoss can accept no responsibility for possible errors in catalogs, brochures, or other printed material. Danfoss reserves the right to alter its products without notice. This also applies to products already on order provided that alterations can be made without subsequential changes being necessary in specifications already agreed. All trademarks in this material are property of the respective companies. Danfoss and the Danfoss logotype are trademarks of Danfoss A/S. All rights reserved.